


NOTE: A Pipe Bushing Will Be Required on all Boots with Pipes Less Than 4"

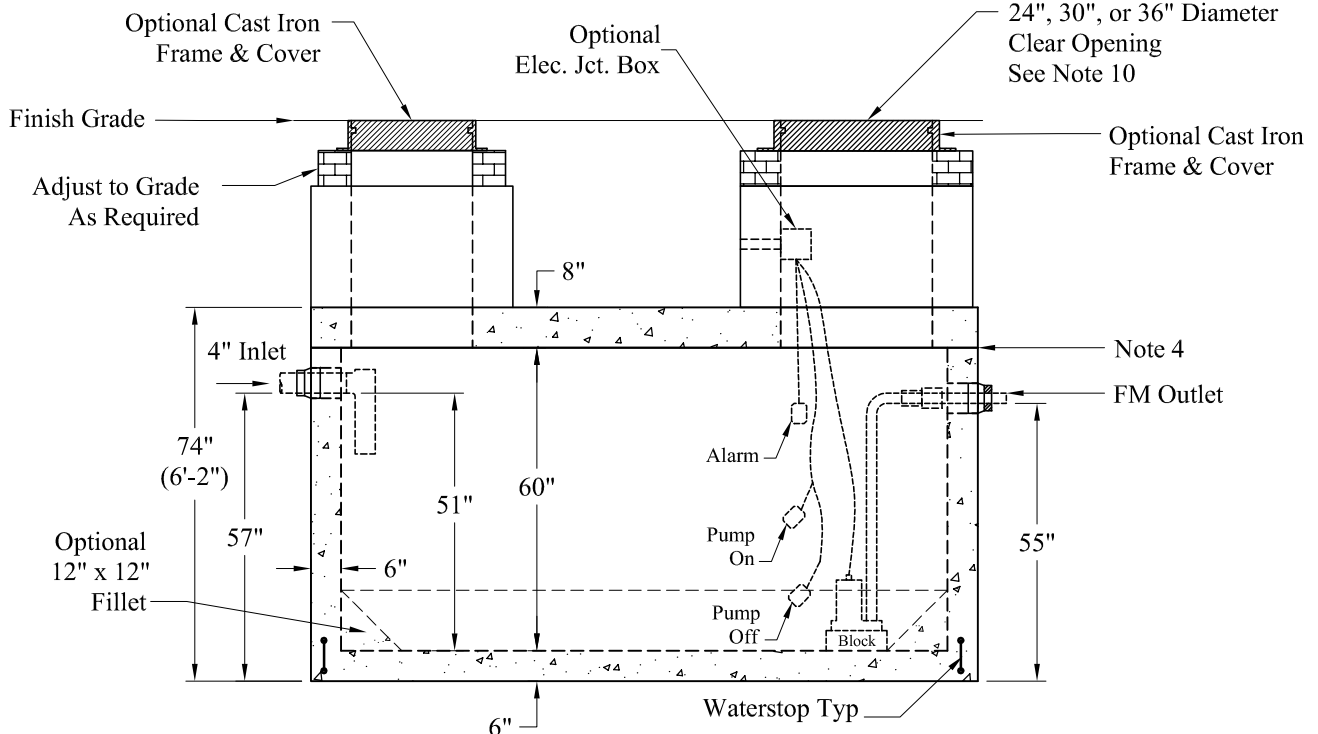

Pumps and Related Accessories are Optional.
Junction Box And Electrical Connections
Installed By Others

- General Notes:**
1. Steel Reinforcement Conforms to Latest ASTM Specifications: ASTM-A615 Grade 60 Rebar
 2. Concrete: $f_c = 5,000$ psi @ 28 Days Minimum
 3. Flexible Sleeves Provided On All Pipe Connections
 4. Butyl Rubber Joint Sealant Provided
 5. Internal PVC Baffle Available Upon Request
 - Inlet: Shall Penetrate at Least 9" Below the Liquid Level
 6. Design Loading: AASHTO-HS20-44, ASTM C-890-06
 7. Design Specified As: ASTM C-1227-08, ASTM C-913-08
 8. Other Inlet/Outlet Pipe Sizes Available
 9. Liquid Level: 450 Gals/VF (38 Gals/In)
4" PVC = 1,800 Gals 6" PVC = 1,764 Gals
 10. As Required by Designer

Est Weights:
Top Slab - 7,100 Lbs
Base - 18,300 Lbs
Total: 25,400 Lbs

Elevations:	
Rim:	
Invert In:	
Alarm On:	
Pump On:	
Pump Off:	
Inside Floor:	

Phoenix Precast Products	1,750 Gallon HS-20 Pump Tank
	Phoenix Precast Products