

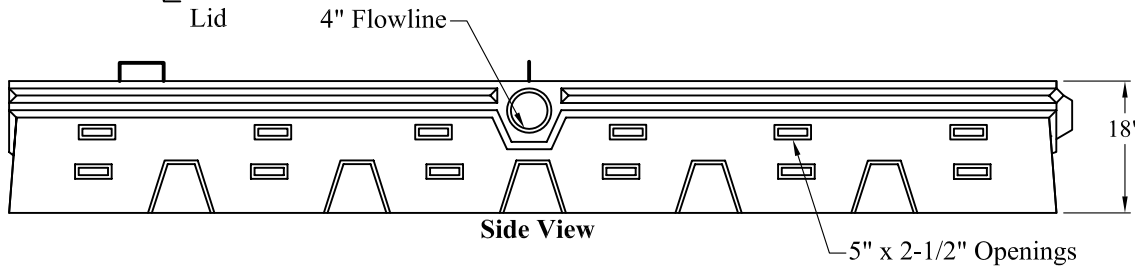


Top View

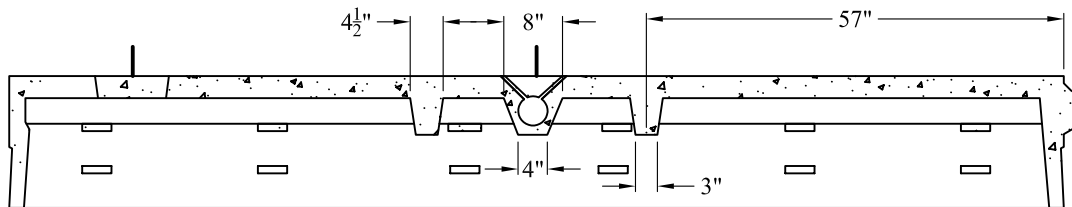

Side View

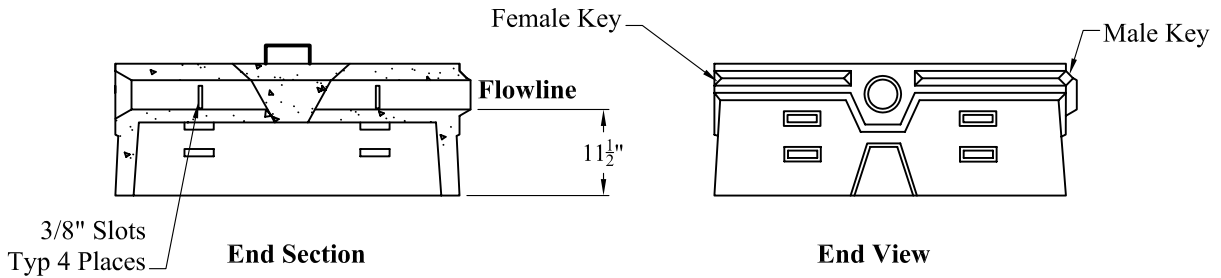

Side Section

General Notes

1. Steel Reinforcement Conforms to Latest ASTM Specifications: ASTM-A615 Grade 60 Rebar
2. Concrete: $f_c = 4,000$ psi @ 28 Days Minimum
3. Design Loading: AASHTO- HS20-44
4. Distribution Line Running Across Chamber
5. Est Weight: 3,200 Lbs

Phoenix
Precast
Products

4Ft x 12Ft x 18In
"S" Flow Diffuser
Leaching Chamber