

Liquid Level:


9' x 16' = 1,080 Gals/VF
 9.5' = 10,260 Gallons Per Tank

20,520 Total Gallons

Ø8" SDR-35 Vent Sealed With Flexible Pipe Sleeve Connection (Typ.)

Est Weights: (Each Tank)

Top Slab:	16,400 Lbs
7' Riser:	26,960 Lbs
Base:	28,350 Lbs
Total:	71,710 Lbs

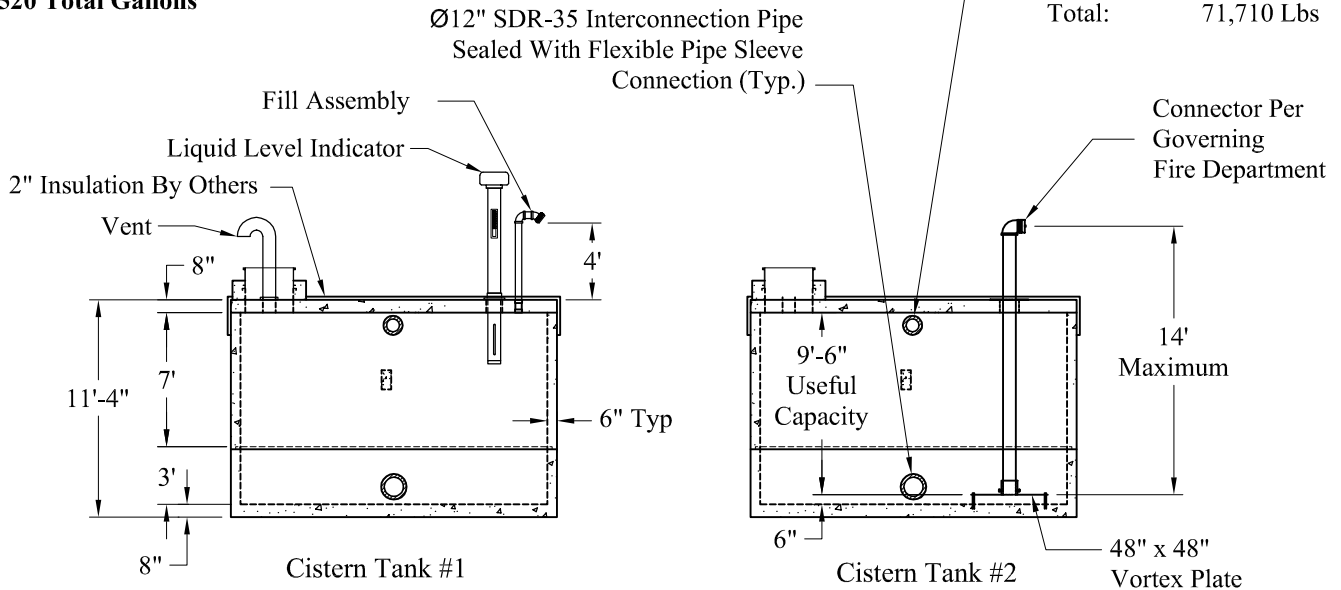

Note: Dimensions Typical For Both Tanks

Foundation And Backfill Notes:

1. Foundation Material Shall Be ¾" Crushed stone, Minimum 12" Thick, Compacted.
2. 1-½" Bank Run Gravel Shall Be Used For Backfill Operations Surrounding Tank. Backfill Shall Be Placed in Maximum 12" Loose Lifts. All Compaction Shall Be Done With Hand Operated Equipment.
3. Tank Excavation Shall Be Kept Dewatered Throughout Installation and Backfill Operations.
4. All Area Between Tanks Shall Be Filled To A Minimum Of 12" Above Crown Of Interconnection Pipe With ¾" Crushed Stone. 1-½" Bank Run Gravel May Be Used Above This Elevation.

General Notes:

1. Concrete: fc = 5,000 psi @ 28 Days Minimum Type III Cement
2. Reinforcing Steel: ASTM-A615 Grade 60 Black Deformed Bars
3. Design Loading: AASHTO-HS20-44, ASTM C-890-06
Design Specified As: ASTM C-1227-08, ASTM C-913-08
4. Butyl Rubber Joint Sealant Provided
5. Includes Exterior Dampproofing
6. Detail Drawings Provided Upon Request

Phoenix Precast Products	20,000 Gallon HS-20 Cistern Assembly (2 Tanks)
	P/N: Concord, NH 03301