



Pipe Chart		
Pipe	Pipe OD	Connection
V		
E		
I		
F		
D		
B		

- 1.) Steel Reinforcement Conforms To Latest ASTM Specifications:
ASTM A-615 Grade 60 Black Deformed Bars
- 2.) Concrete: $f_c = 5,000$ PSI @ 28 Days Minimum, Type III Cement
- 3.) Butyl Rubber Joint Sealant Conforms to ASTM C-990 and Federal Spec SS-S-210A.
- 4.) Flexible Connection Provided For All Pipe Connections.
- 5.) All Pumps, Mounting Hardware, and Related Ancillary Equipment Provided by Others.
- 6.) Liquid Capacity = 878 Gallons/Vertical Foot (73 Gallons/Inch)
- 7.) AASHTO-HS20-44 Design Loading Conforms to Latest Specifications ASTM C 890 & C 913
- 8.) Hatch to Drain Into Wet Well Unless Otherwise Noted
- 9.) Bouyancy Calculations Provided With Shop Drawing Submittal

- Options:
- LinkSeal Pipe Connections
 - LinkSeal Electrical Connections
 - Exterior Damp Proofing/Water Proofing
 - Interior Coatings
 - Interior Fillet
 - Exterior Joint Wrap
 - Safety Net, Safety Grate
 - Winch Socket

Est Weights:	
- Top Slab:	18,200 Lbs
- Risers:	4,800 Lbs/VF
- 1' x 1' Fillet:	3,000 Lbs
- Ext Base Slab:	17,250 Lbs

Elevation Chart		
Description	Elevation	
R	Rim	
G	Finish Grade	
V	Vent	
E	Electric Connection(s)	
I	Inlet	
F	Force Main Outlet	
D	Drain Back from Valve Vault	
B	Inside Bottom Floor	
C	Outside Bottom of Concrete	

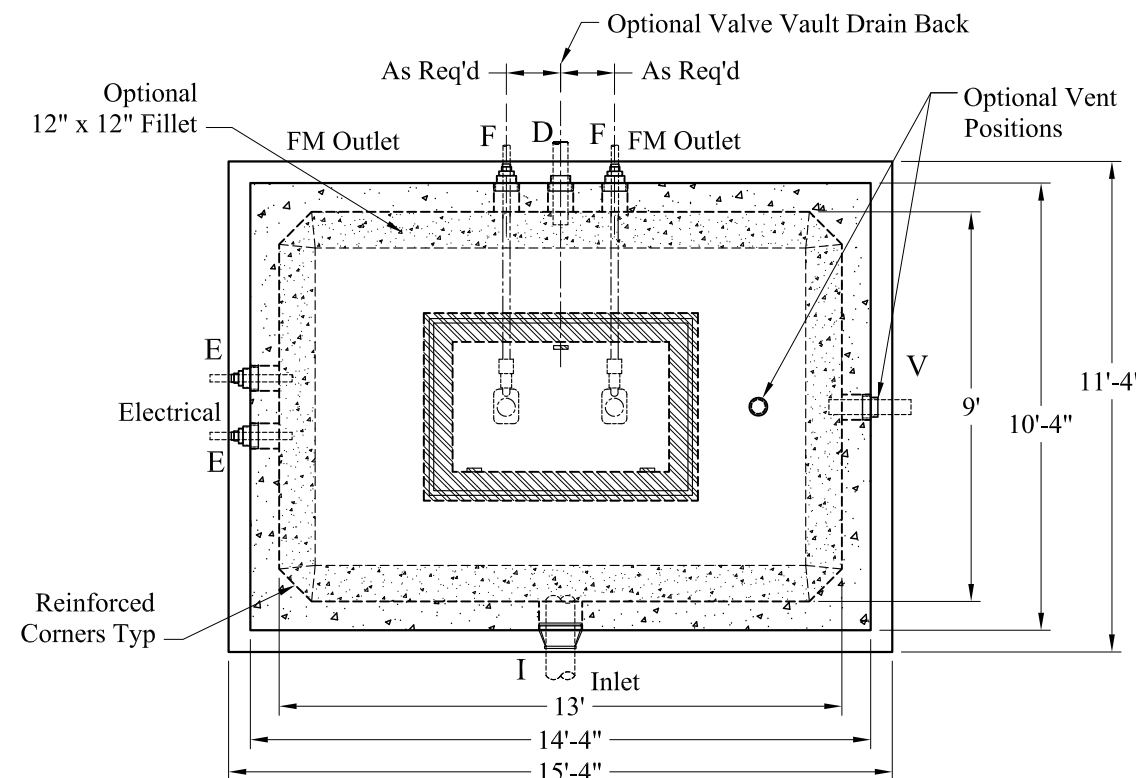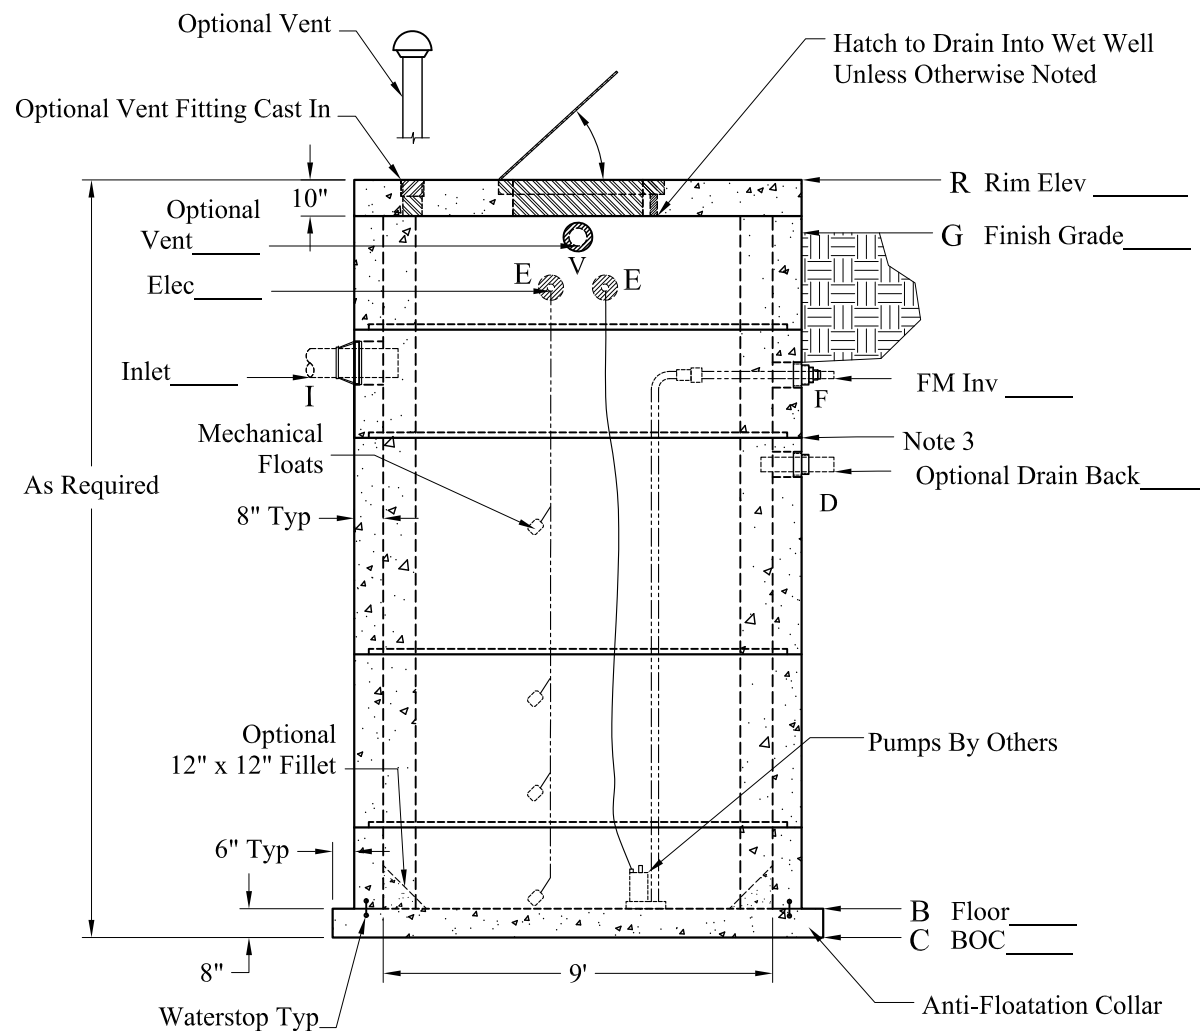

*Alternate for 12'Ø Wet Well

Phoenix Precast Products	9' x 13' Pump Station Wet Well Extended Base
	P/N: Custom As Required