


Liquid Level:

7' x 15' = 787 Gals/VF
 @ 7.00' = 5,500 Gallons
 Per Tank

Total: 11,000 Gallons

Est Weights: (Each Tank)

Top Slab:	16,000 Lbs
5' Riser:	18,050 Lbs
Base:	22,850 Lbs
Total:	56,900 Lbs

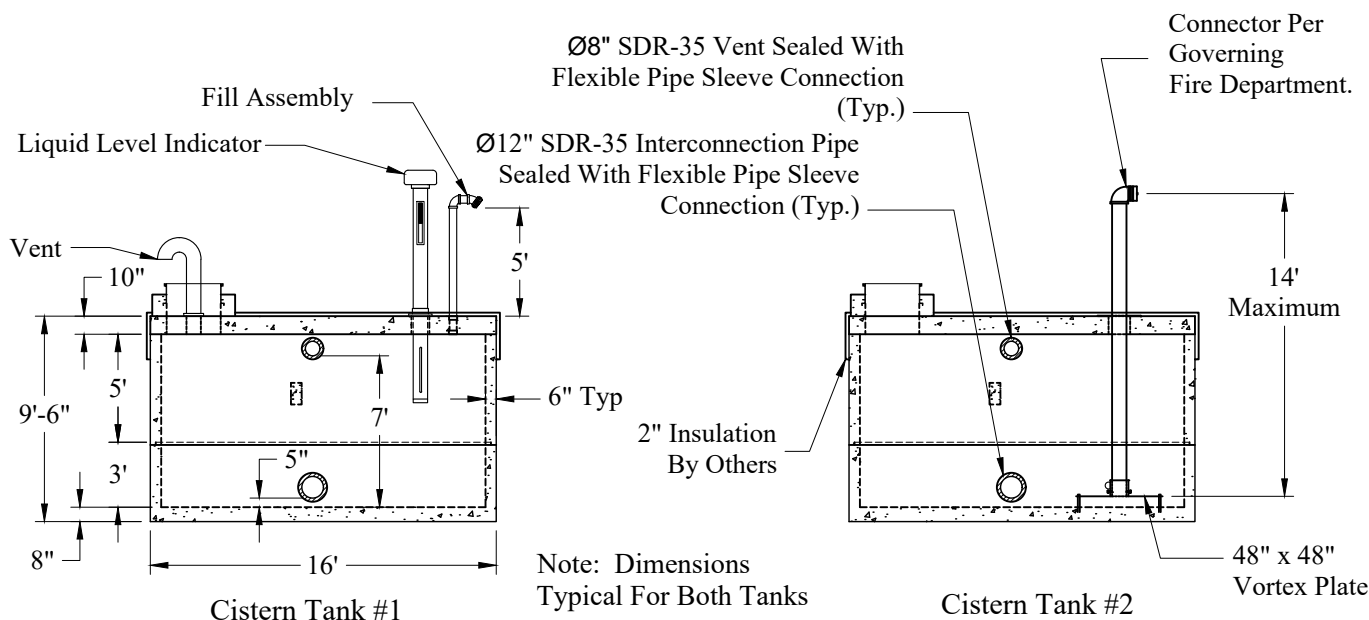

Foundation And Backfill Notes:

1. Foundation Material Shall Be ¾" Crushed stone, Minimum 12" Thick, Compacted.
2. 1-½" Bank Run Gravel Shall Be Used For Backfill Operations Surrounding Tank. Backfill Shall Be Placed in Maximum 12" Loose Lifts. All Compaction Shall Be Done With Hand Operated Equipment.
3. Tank Excavation Shall Be Kept Dewatered Throughout Installation and Backfill Operations.
4. All Area Between Tanks Shall Be Filled To A Minimum Of 12" Above Crown Of Interconnection Pipe With ¾" Crushed Stone. 1-½" Bank Run Gravel May Be Used Above This Elevation.

General Notes:

1. Concrete: $f_c = 5,000$ psi @ 28 Days Minimum Type III Cement
2. Reinforcing Steel: ASTM-A615 Grade 60 Black Deformed Bars
3. Design Loading: AASHTO-HS20-44, ASTM C-890-06
Design Specified As: ASTM C-1227-08, ASTM C-913-08
4. Butyl Rubber Joint Sealant Provided
5. Includes Exterior Dampproofing
6. Detail Drawings Provided Upon Request

Phoenix
 Precast
 Products

10,000 Gallon HS-20
 Cistern Assembly
 (2 Tanks)

P/N: Custom As Required
 Concord, NH 03301