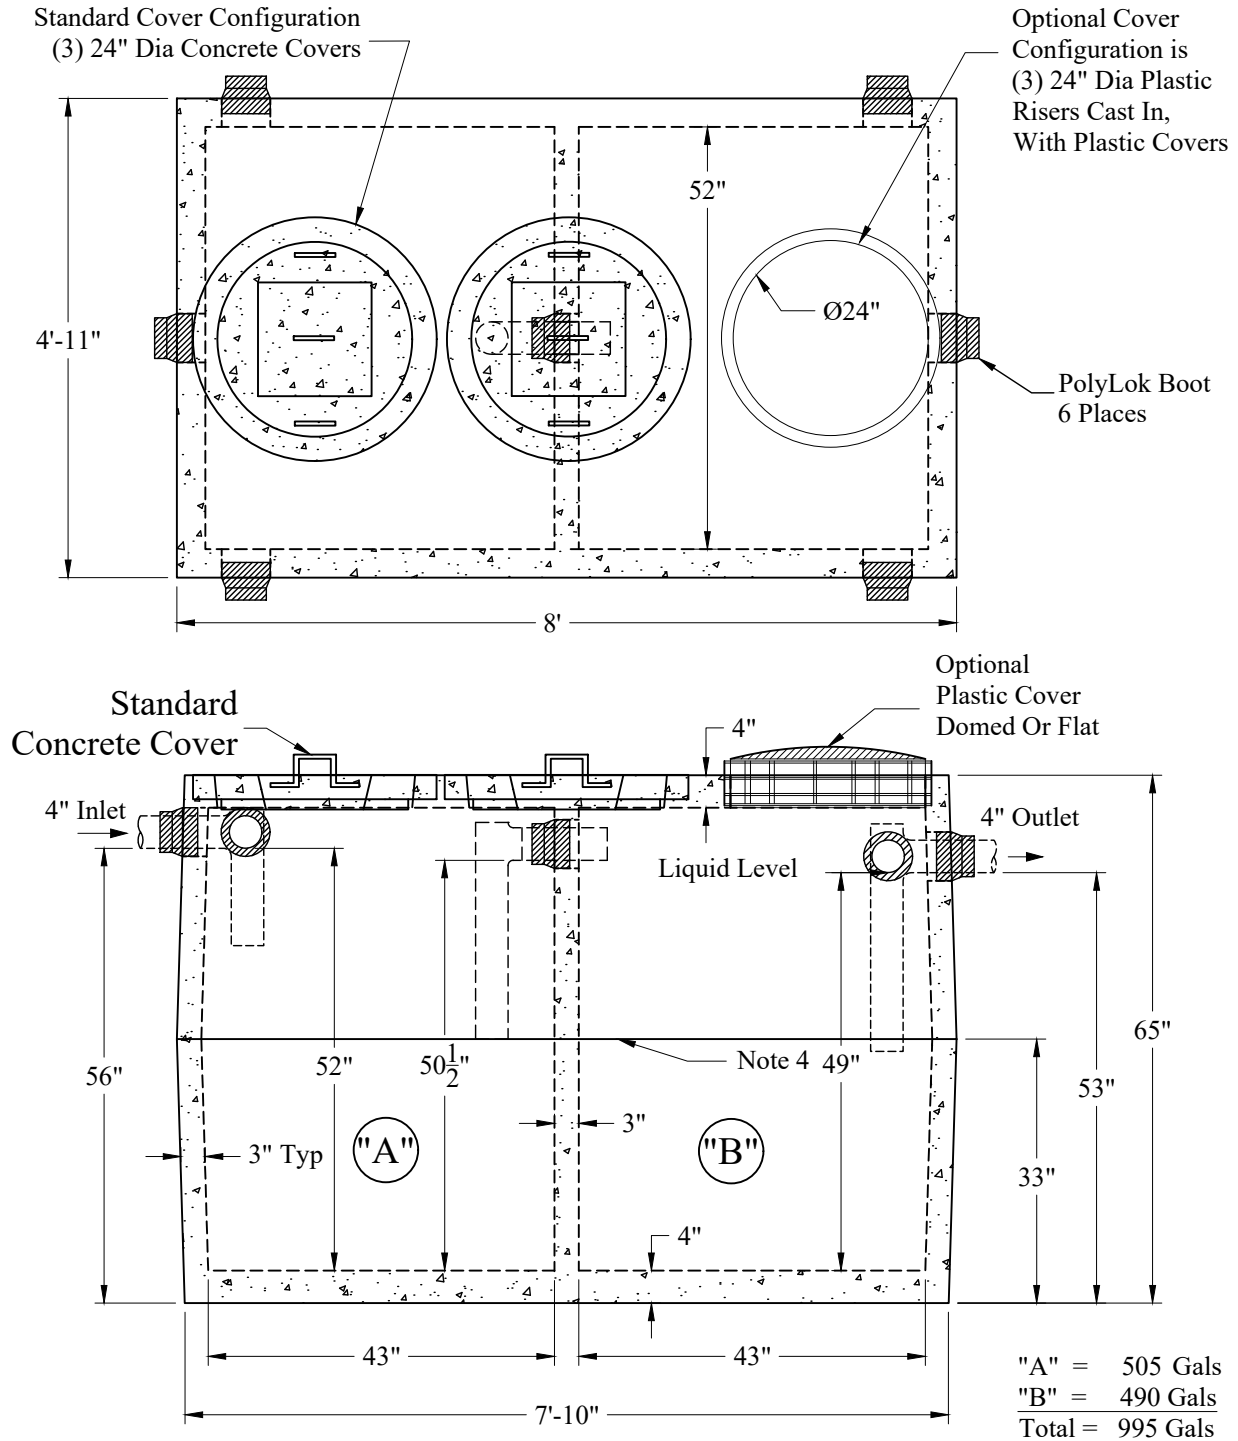


**General Notes**

1. Steel Reinforcement Conforms to Latest ASTM Specifications: ASTM-A615 Grade 60 Rebar
 2. Concrete: $f_c = 4,000$ psi @ 28 Days Minimum
 3. Flexible Sleeves Used On All Pipe Openings
 4. Butyl Rubber Joint Sealant Provided
 5. Internal PVC Baffles Available
- Inlet: Shall Penetrate at Least 9" Below the Liquid Level But Not Deeper Than the Outlet Baffle.
- Outlet: Shall Extend Below the Surface of the Liquid Equal to 40% of the Liquid Depth (20").
6. LD Tanks: 3' Cover Max, Non-Traffic

(Std Cover) P/N: MST-500/500TOPLD Top: 4,400 Lbs
(Plastic Cover) P/N: MST-WW500/500LDTOP Top: 4,400 Lbs
P/N: MST-500/500BOTLD Bottom: 4,400 Lbs
Total Reg or Plastic: 8,800 Lbs

Phoenix
Precast
Products

500/500 Gallon LD
2 Compartment Tank

P/N: ST-500/500LD
P/N: ST-500/500PLSLD

Concord, NH 03301